

INSTALLATION INSTRUCTIONS

CT1W Select Series Room CO₂ & CO₂/T Transmitters



IMPORTANT WARNINGS

- Only qualified trade installers should install this product
- This product is not intended for life-safety applications
- Do not install in hazardous or classified locations
- The installer is responsible for all applicable codes
- De-energize power supply prior to installation or service



PRODUCT APPLICATION LIMITATION:

Senva products are not designed for life or safety applications. Senva products are not intended for use in critical applications such as nuclear facilities, human implantable device or life support. Senva is not liable, in whole or in part, for any claims or damages arising from such uses.


INSTALLATION

1. IMPORTANT! Locate sensor in an area away from ventilation sources and heat generating equipment and appliances. Sensor should be mounted at light switch height in a vertical orientation. Use insulating material behind sensor to ensure reading accuracy.

NOTE: Do not install sensor in multi-gang electrical boxes with line voltage or other electrical devices.

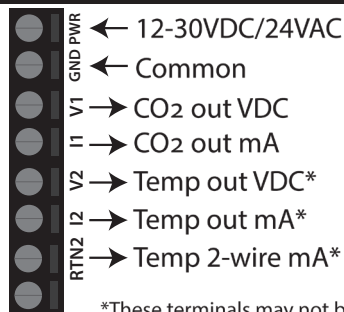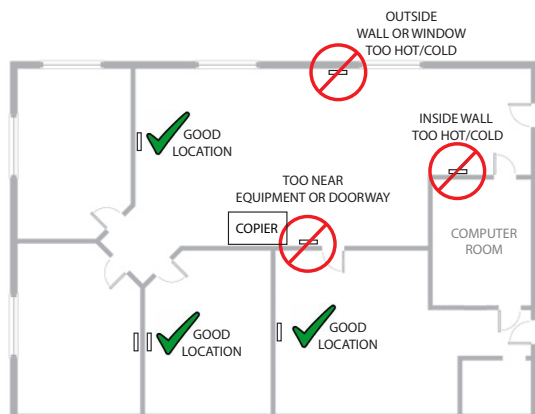


*These terminals may not be populated, depending on which model is ordered.



2. Wire sensor as shown above.

3. Set DIP switch positions on (front of device) to accommodate your application. DIP switch 2 only applies to units with transmitter temperature output selected.

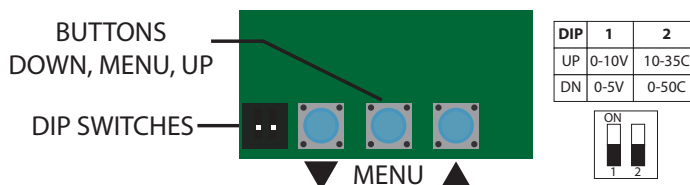

4. Apply power to sensor.

OPERATION

Press center MENU button to cycle between:

- SC** L Scaling "2" = 2000ppm, "5" = 5000ppm, "10" = 10000ppm
- SP** H Setpoint, Hi (Closed above this level)
- SP** L Setpoint, Lo (Open below this level)
- Adj** Manual calibration adjustment +/-250ppm
- CL** *Automatic calibration - ON/OFF


The upper ▲ arrow and lower ▼ arrow will show the current setting and then adjusted values on consecutive presses.

For No Display, the output is set to 0-2000ppm and ABC is ON

*For continuously occupied areas or greenhouses, it is recommended to turn automatic calibration to 'off'.

CT1R-XXX-D (Dual Channel CO₂) products will have calibration 'off' by default.


DIMENSIONS

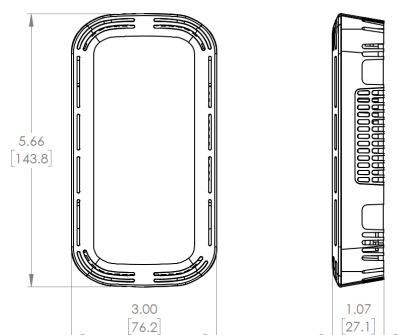

FEATURE - LID LOCKS

The CT1W comes standard with locks to keep the lid from being removed, to stop unwanted tampering. There is a Lock located at all 4 lid snaps.

To Lock:

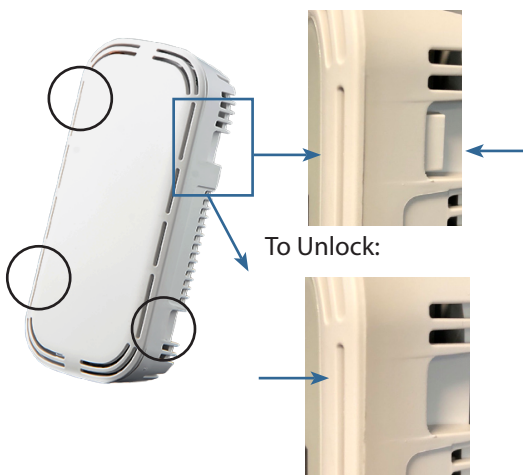

Once lid had been installed, while applying pressure to keep lid in place, push in tabs on the back of the device. Locks will *Click* into place.

Place a small screwdriver in designated vent, push in to release the lock.

CALIBRATION

Automatic Calibration feature:

The sensor will automatically track low ambient CO₂ levels and gradually make adjustments to compensate for sensor drift due to long-term aging of the IR light source.

Senva CO₂ sensors are factory calibrated to controlled test gases. No field calibration is necessary or recommended. However, to facilitate compliance with job requirements and commissioning procedures, provisions for field calibration are provided:

1. Locate calibration instrument and sensor in close proximity to each other in a controlled environment free of drafts, people, and equipment to reduce influence on CO₂ and temperature.
2. Compare output of sensor to calibration instrument, and note difference. (In 0-10V mode/2000ppm range, 1V = 200ppm)
3. Using the buttons on front of unit, adjust offset value for CO₂ as needed. Factory calibration may be restored by setting offset back to 0.

In extreme cases where the sensor module has been damaged, a new module may be installed in the field. Consult factory for replacement module and instructions.

TROUBLESHOOTING

Symptom	Solution
No output	Check wiring. Ensure power supply meets requirements.
CO ₂ reading error	Verify control panel software is configured for correct output scaling.
	Verify accuracy of test instrument. Observe installation and calibration guidelines
	Install insulation foam gasket provided to prevent thermal conduction from inside wall.
	Perform calibration only if necessary.

SPECIFICATIONS

AC Supply	24VAC ⁽¹⁾ 100mA max
DC Supply	12-30VDC, 50mA max
Outputs	
CO ₂ and Temperature (option)	3-wire 4-20mA, 0-5V or 0-10V ⁽²⁾ (selectable)
Relay	Solid state, 1A@30VAC/DC, N.O.
Output scaling	
CO ₂	0-2000ppm (default), 0-5000ppm, or 10,000ppm (selectable)
CO₂ Sensor Performance	
Type	Non-dispersive Infrared (NDIR)
Accuracy (Standard)	±(30ppm +3% of reading) (400-2000ppm), @ -10-50°C
	±(50ppm +5% of reading) (2000-5000ppm), @ -10-50°C
	±(100ppm +10% of reading) (5000-10000ppm), @ 0-50°C
	±(30ppm +3% of reading) (0-2000ppm), @ 0-50°C
Accuracy (Dual Channel)	±(50ppm +3% of reading) (2000-5000ppm), @ -10-50°C ±(100ppm +10% of reading) (5000-10000ppm), @ 0-50°C
Drift with ABC disabled (Standard)	35ppm/month ⁽³⁾
Drift with ABC disabled (Dual Channel)	5ppm/month ⁽³⁾
Range	0-2000/5000ppm; Programmable up to 10,000ppm
Response time	60s to 90% reading
Output update rate	1s
Element Operating Environment ⁽⁴⁾	14 to 122°F (-10 to 50°C), 0 to 95% RH
Temperature Transmitter	
Accuracy	<±0.2°C
Resolution	0.01°C
Repeatability	0.04°C
Response time	2s
Output update rate	0.5s
Element Operating range	-40 to 140°F (-40 to 60°C)
Environmental	
Enclosure Rating	IP20/NEMA 1
Max Operating Temp	14 to 122°F (-10 to 50°C)
Compliance	
Agency	CE, RoHS

(1) One side of transformer secondary is connected to signal common. Dedicated transformer is recommended.

(2) 15-30VDC/24VAC power supply voltage required for 10 Volt output.

(3) It is not recommended to de-activate ABC (auto-calibration) except for continuously occupied spaces or greenhouses. Drift ratings may vary based on environment.

(4) Operation outside of element operating environment may result in reduced accuracy.